


2" Flushing Pipe & Box - End of Water Main
16" Valve & Box
16" x 12" Tee

16" x 12" Tee
6" Valve & Box
6" Hydrant

AURORA ROAD (S.R.82)

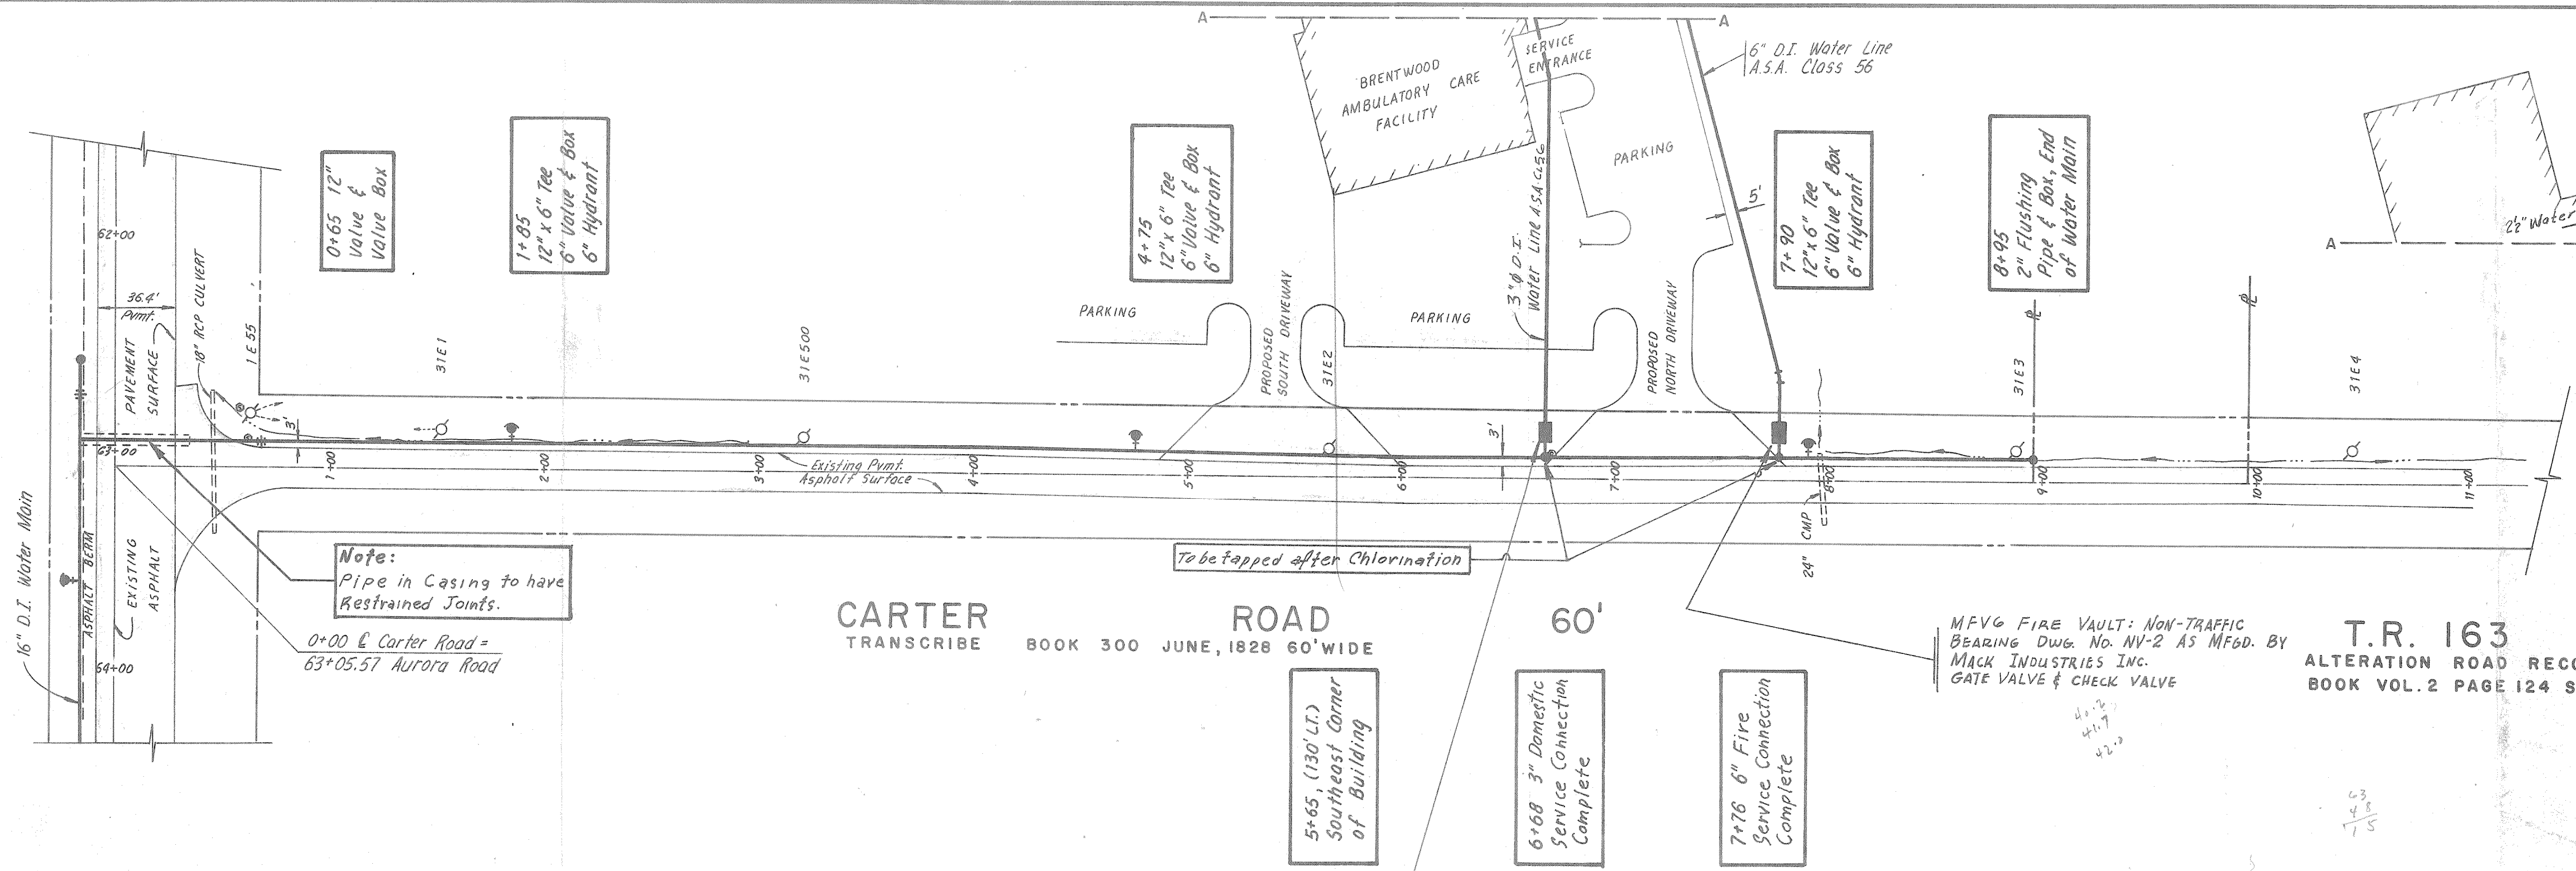

Note:
Pipe in Casing to have Restrained Joints.
0+00 to Carter Road = 63+05.57 Aurora Road

CARTER ROAD
TRANSCRIBE BOOK 300 JUNE, 1828 60' WIDE

To be tapped after Chlorination

5+65, (130' LT.)
Southeast Corner of Building

6+68 3" Domestic Service Connection Complete

7+76 6" Fire Service Connection Complete


MFVG FIRE VAULT: NON-TRAFFIC BEARING DWG. NO. NV-2 AS MFGD. BY MACK INDUSTRIES INC. GATE VALVE & CHECK VALVE

T.R. 163
ALTERATION ROAD RECORD
BOOK VOL. 2 PAGE 124 SEPT. 8, 1857

CHAGRIN VALLEY ENGR.
SCAN DATE: 12/17/2023
SCAN FILE: 12171
JOB #: 22228

18" x 36" Sheet

M8 MV METER VAULT: NON-TRAFFIC BEARING DWG. NO. NV-6 AS MFGD. BY MACK INDUSTRIES INC. METER, BY PASS & GATE VALVE 2-GATE VALVES & 1 CHECK VALVE

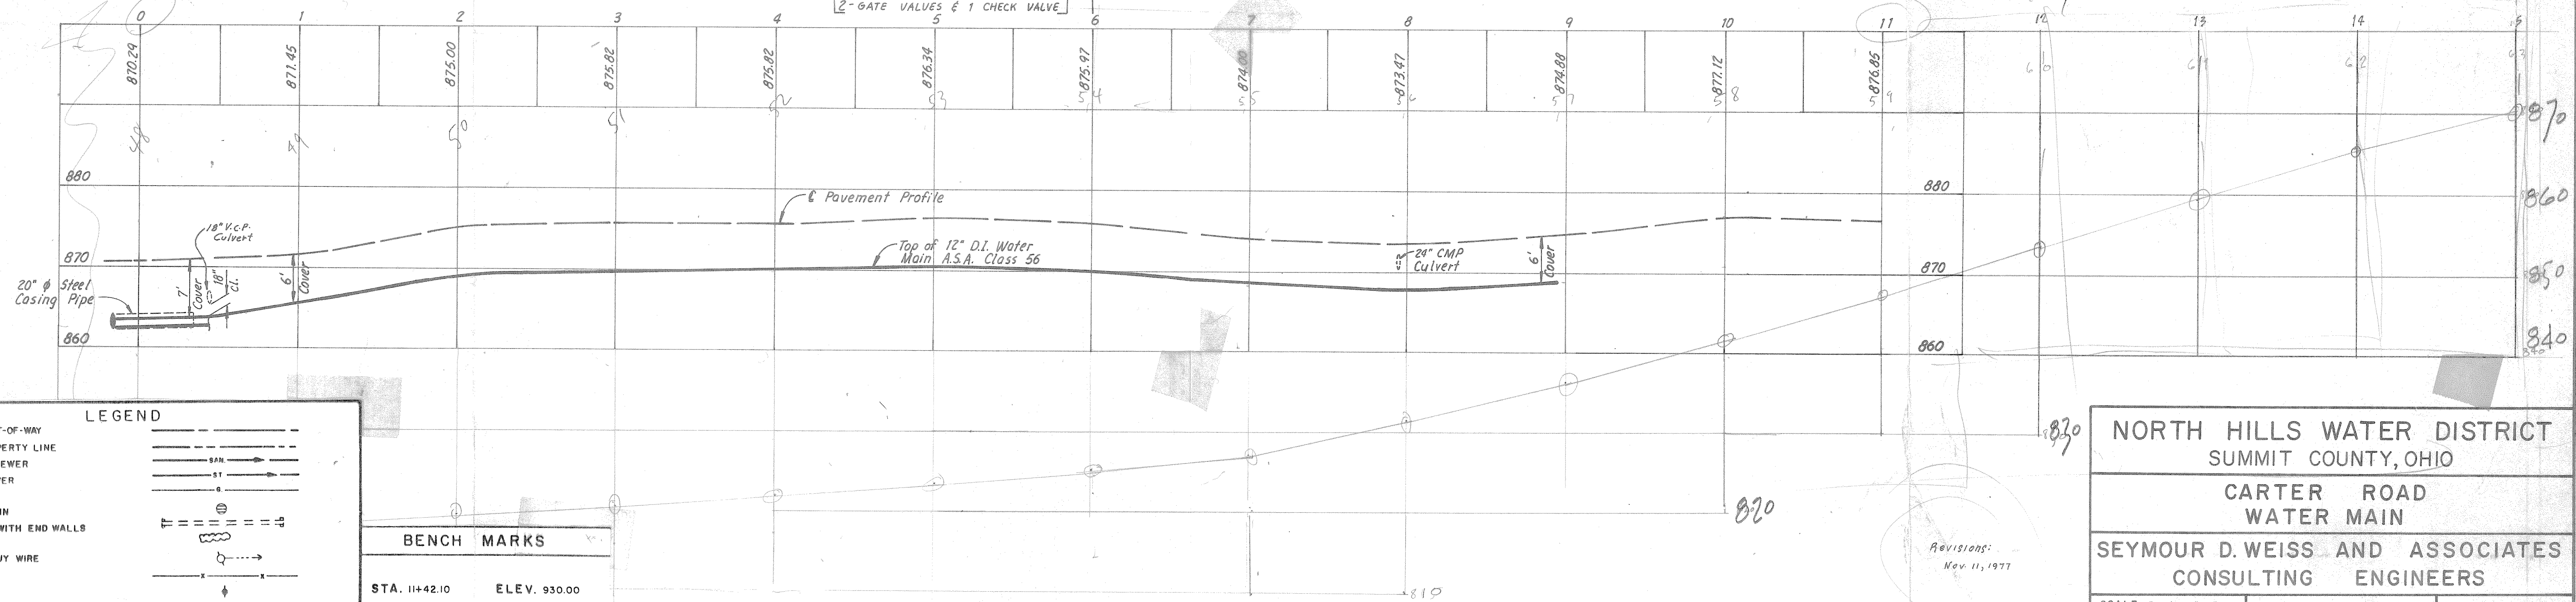

LEGEND

- CENTERLINE OF RIGHT-OF-WAY
- RIGHT-OF-WAY OR PROPERTY LINE
- EXISTING SANITARY SEWER
- EXISTING STORM SEWER
- EXISTING GAS MAIN
- EXISTING CATCH BASIN
- DRIVEWAY CULVERT WITH END WALLS
- TREE OR BUSH
- UTILITY POLE AND GUY WIRE
- FENCE
- MAIL BOX
- SIGN
- ORNAMENTAL LAMP POST

BENCH MARKS	
STA. 11+42.10	ELEV. 930.00
STA. 21+93.99	ELEV. 947.44

NORTH HILLS WATER DISTRICT
SUMMIT COUNTY, OHIO

CARTER ROAD WATER MAIN

SEYMOUR D. WEISS AND ASSOCIATES
CONSULTING ENGINEERS

SCALE 1"=50'H. 1"=10'V.	P 7710- 1239 NH	SHEET NO. 3 OF 3
DATE OCTOBER, 1977		
DRAWN: REM		

Revisions:
Nov. 11, 1977